

6'-0" X 10'-0" RIVERSIDE DUCTED VAULT X 7'-0" DEEP

NOTES:

- VAULT DESIGNED IN ACCORDANCE WITH AASHTO H-20-44 TRAFFIC BRIDGE LOADING USING 5,500 PSI [37.92MPa] COMPRESSIVE STRENGTH CONCRETE AND 60,000 PSI [413.2MPa] YIELD STRENGTH ASTM A-706 STEEL REINFORCEMENT PER CALCS. #31570.

- VAULT TO BE PLACED ON A 6" BASE OF CRUSHER RUN FOR EASE OF INSTALLATION AND EVEN LOAD DISTRIBUTION.
- LIMITS OF COVER OVER ROOF SECTION IS 6" TO 4'-0".


ORDERING INFORMATION:

K610-DV84-21 FOR ASSEMBLY AS SHOWN.
TOTAL WEIGHT OF ASSEMBLY SHOWN IS 28,910 LBS.

- UV610-B24-21, 24" BOTTOM SECTION (R-UV610-B24-21), WT. 12,156 Lbs.
- UV610-T60-21V, 60" ROOF SECTION (R-UV610-T60-21V), WT. 16,754 Lbs.
- 1.5" DIA. x 14" DIA. SUMP x 5" DEEP (5000-247) W/SUMP COVER (08-2102). LOCATE AS FOLLOWS: BOTTOM SECTION (1) TABLE MTD. 24" x 36" DUCTED KNOCKOUT x 12" DEEP (5000-526). LOCATE AS FOLLOWS: ROOF SECTION (2) CORE MTD.
- 18" x 18" KNOCKOUT x 4 1/2" DEEP (5000-192). LOCATE AS FOLLOWS: ROOF SECTION (2) CORE MTD.
- 10" DIA. VENT KNOCKOUT x 5" DEEP. LOCATE AS FOLLOWS: ROOF SECTION (2) CORE MTD.
- 7/8" DIA. x 4 1/2" GALVANIZED PULL IRON WITH LEGS (05-2140). LOCATE AS FOLLOWS: BOTTOM SECTION (2) CORE MTD.; ROOF SECTION (2) CORE MTD.;
- 1/2" PLASTIC INSERT. LOCATE AS FOLLOWS: ROOF SECTION (4) CORE MTD.
- Ø1/2" TREADED BRONZE INSERT BRAZED TO STRUCTURAL STEEL REBAR. "GRD" SHALL BE STENCILED IN RED LETTERS (1 1/2" MIN., 2" MAX.) ON THE CONCRETE ABOVE EACH INSERT, BOTTOM SECTION (2) CORE MTD.; TOP SECTION (4) CORE MTD.
- 4 TON x 4 3/4" GALVANIZED RISS FOR HANDLING. LOCATE AS FOLLOWS: BOTTOM SECTION (4) CORE MTD.
- 4 TON x 9 1/2" GALVANIZED RISS FOR HANDLING. LOCATE AS FOLLOWS: BOTTOM SECTION (4) SURFACE MTD.
- 4 TON x 9 1/2" GALVANIZED RISS FOR HANDLING. LOCATE AS FOLLOWS: ROOF SECTION (4) SURFACE MTD.
- 1" DIA. BLIND GROUND ROD HOLE. LOCATE AS FOLLOWS: BOTTOM SECTION (2) CORE MTD.

GENERAL NOTES:

- Minimum soil bearing capacity is hereby assumed to be 2000 PSF unless otherwise documented by a geotechnical report that shall be provided to Jensen Precast by the end user. Jensen Precast shall not be held responsible for the soil bearing capacity.
- Installation of Manholes, Vaults, Handholes, Meter Boxes etc. will be as per Jensen installation procedures.
- Structural modification to the Jensen line of products is not permitted without prior written approval from Jensen Engineering Department.
- Do not scale the drawings, verify all dimensions including rough openings, if any discrepancies are found, notify the Jensen Engineer immediately.
- The Jensen Engineer will interpret the intent of the drawings in case of possible conflict or discrepancy.
- Permissible Variations: Dimensional Tolerances - The length, width, height, or dia. measurements of the structure when measured on the inside surfaces shall not deviate from design dimensions by more than the following: Tolerance: 0 to 5 Feet 1/4" 5 to 10 Feet 3/8" 10 to 20 Feet as agreed upon between the supplier and purchaser. Squariness Tolerance: he inside of the precast concrete component shall be square as determined by diagonal measurements. The difference between such measurements shall not exceed the following: Measured Length: Allowable Difference 0 to 10 Feet 1/2" 10 to 20 Feet 3/4" 20 Feet and over as agreed upon between the supplier and purchaser.

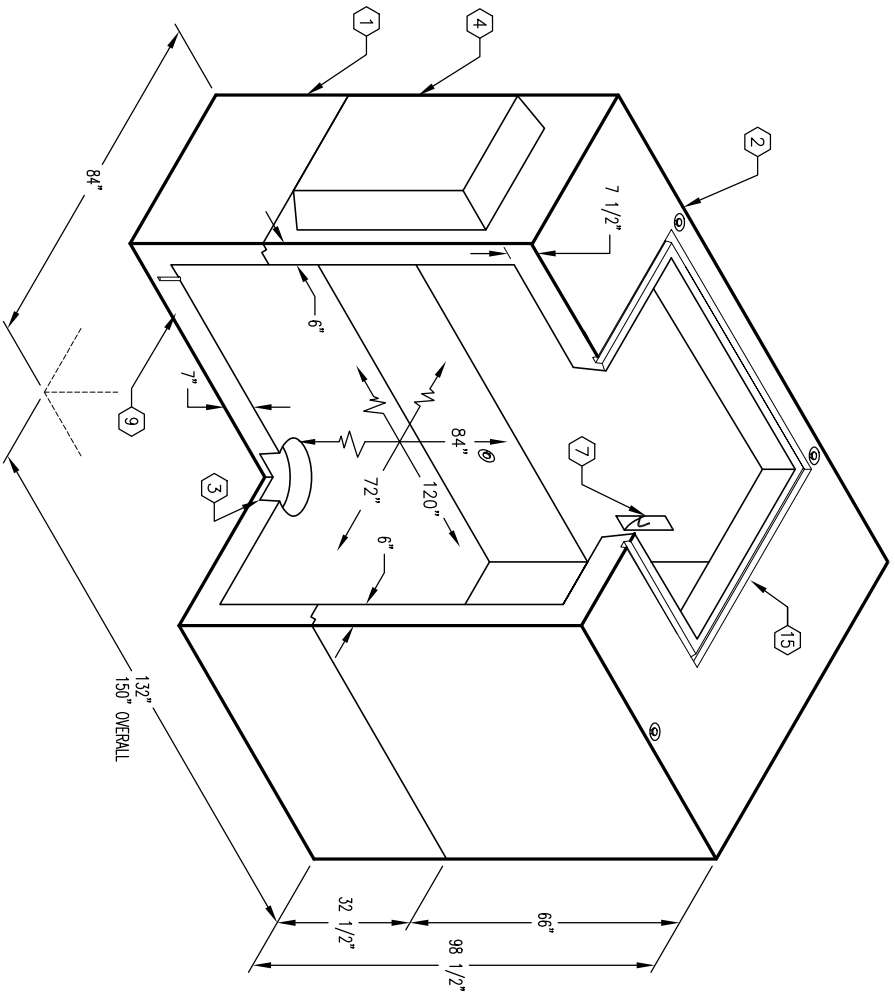

MINIMUM EXCAVATION SIZE:
8'-0" x 13'-6" x DEPTH REQD.


K610-DV84-21

PER CITY OF RIVERSIDE UDS 005 ITEM 3


03-01-02




ANACAO REL. 14

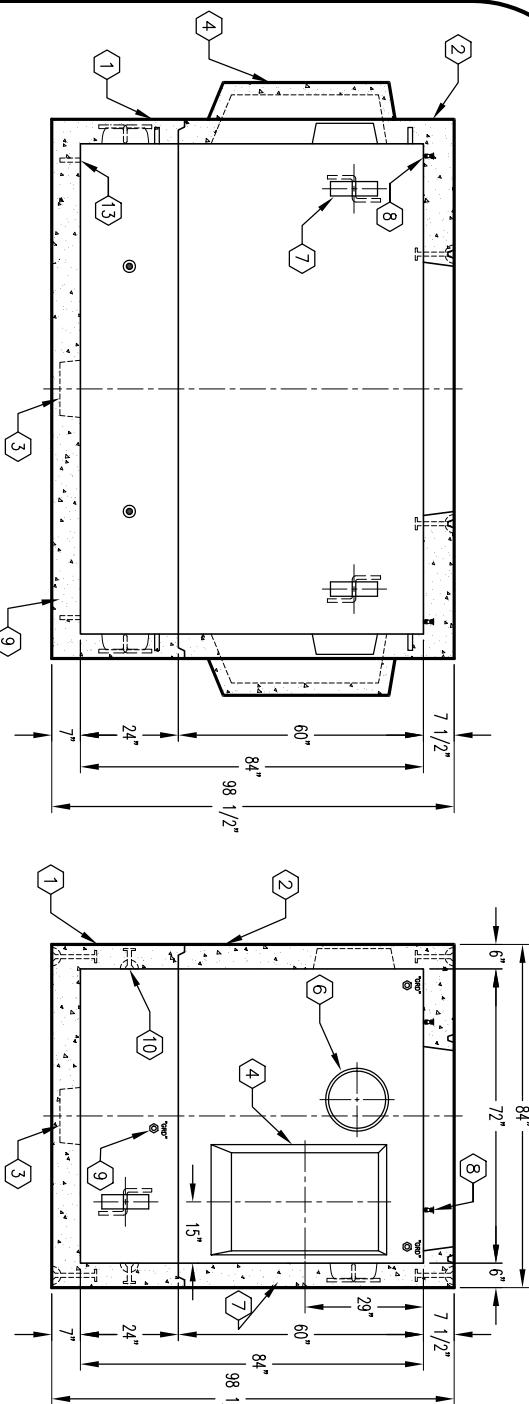

SECTION A-A

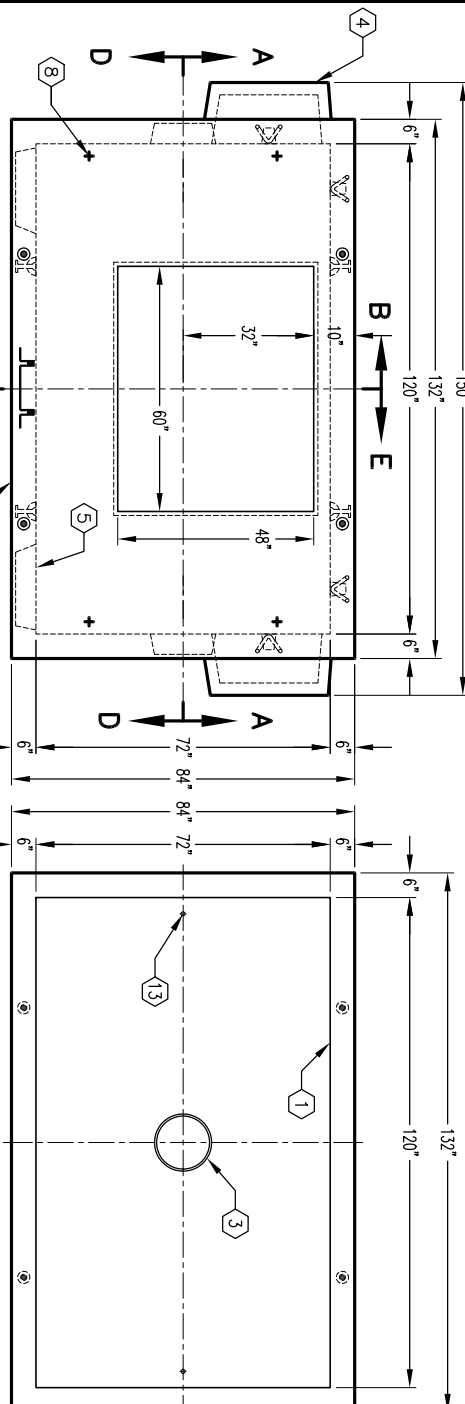


SECTION B-B

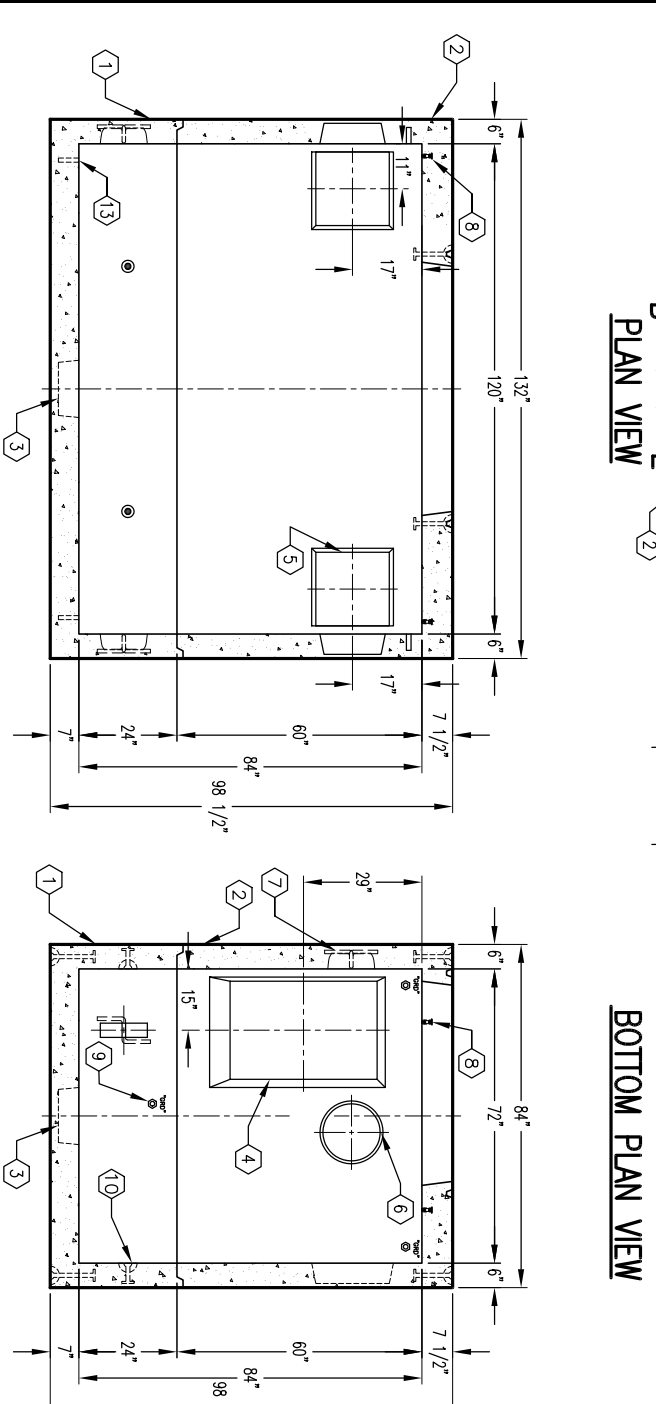


PLAN VIEW


BOTTOM PLAN VIEW

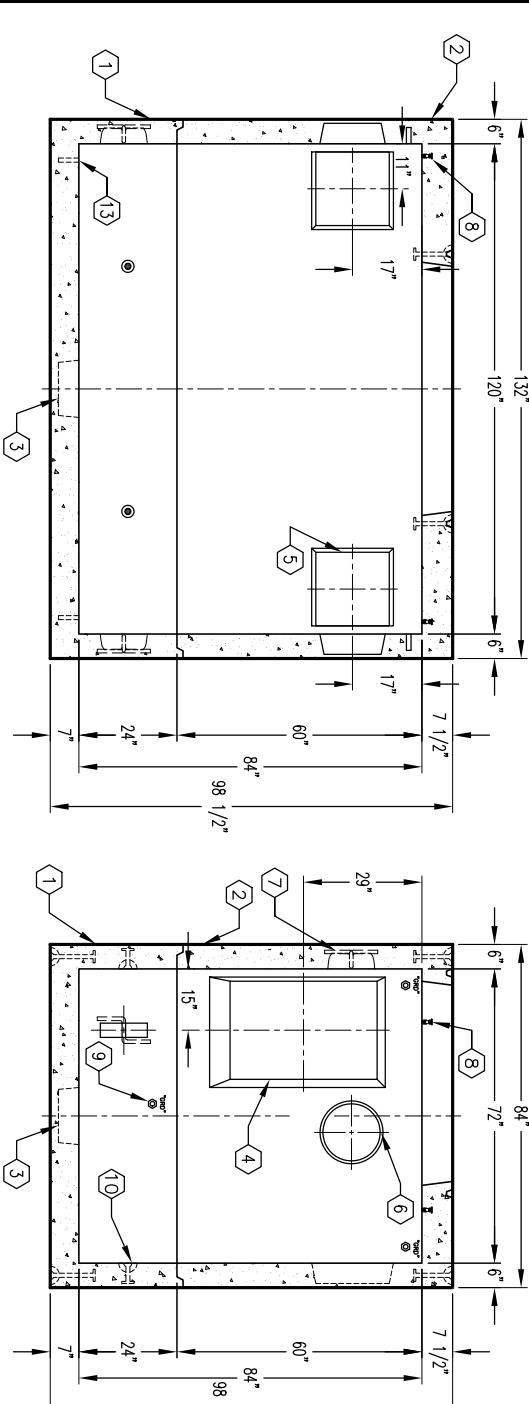

SECTION D-D

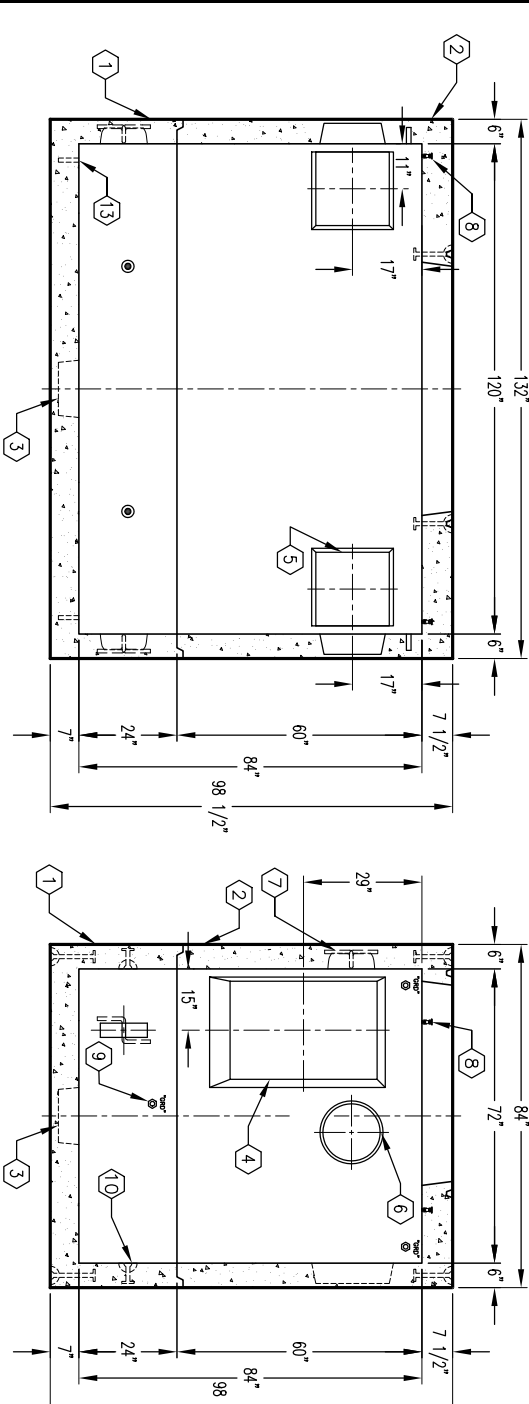

SECTION E-E



K610-DV84-21

PER CITY OF RIVERSIDE UDS 005 ITEM 3

03-01-02

#	DATE	DESCRIPTION	BY