

7'-6" x 8'-1" SDG&E TRANSFORMER PAD-3427

NOTES:


- PAD DESIGNED FOR 300 PSF PARKWAY LOADING LOADING USING 5,500 PSI [37.92MPa] COMPRESSIVE STRENGTH CONCRETE AND 60,000 PSI [413.2MPa] YIELD STRENGTH GRADE 60 A-706 REINFORCEMENT PER CALC. #31427.
- PAD SHALL BE STENCILED, "JENSEN PRECAST", WITH "TIME" AND "DATE OF POUR" AND S.D.G. & E. STOCK NUMBER ON THE EXTERIOR EDGE OF PAD.

1. PD9096-T6-10, 90" x 97" TRANSFORMER x 6" THICK. WT. 4,186 lbs.
2. 18" x 54" CABLE OPENING; DRAFT 1/2" ALL SIDES (1) TABLE MTD.
3. 1 5/8" x 1 5/8" GALV. UNISTRUT X 11" LONG (1) PAN MTD.
4. 1 5/8" x 1 5/8" GALV. UNISTRUT X 27" LONG (1) PAN MTD.

ORDERING INFORMATION

PD9096-T6-10 FOR ASSEMBLY AS SHOWN APPROVED FOR SAN DIEGO GAS & ELECTRIC SPEC. 3427. TOTAL WEIGHT OF ASSEMBLY IS 4,186 lbs.

JENSEN STOCK # PD9096-T6-10 S.D.G. & E. STOCK #: 514012

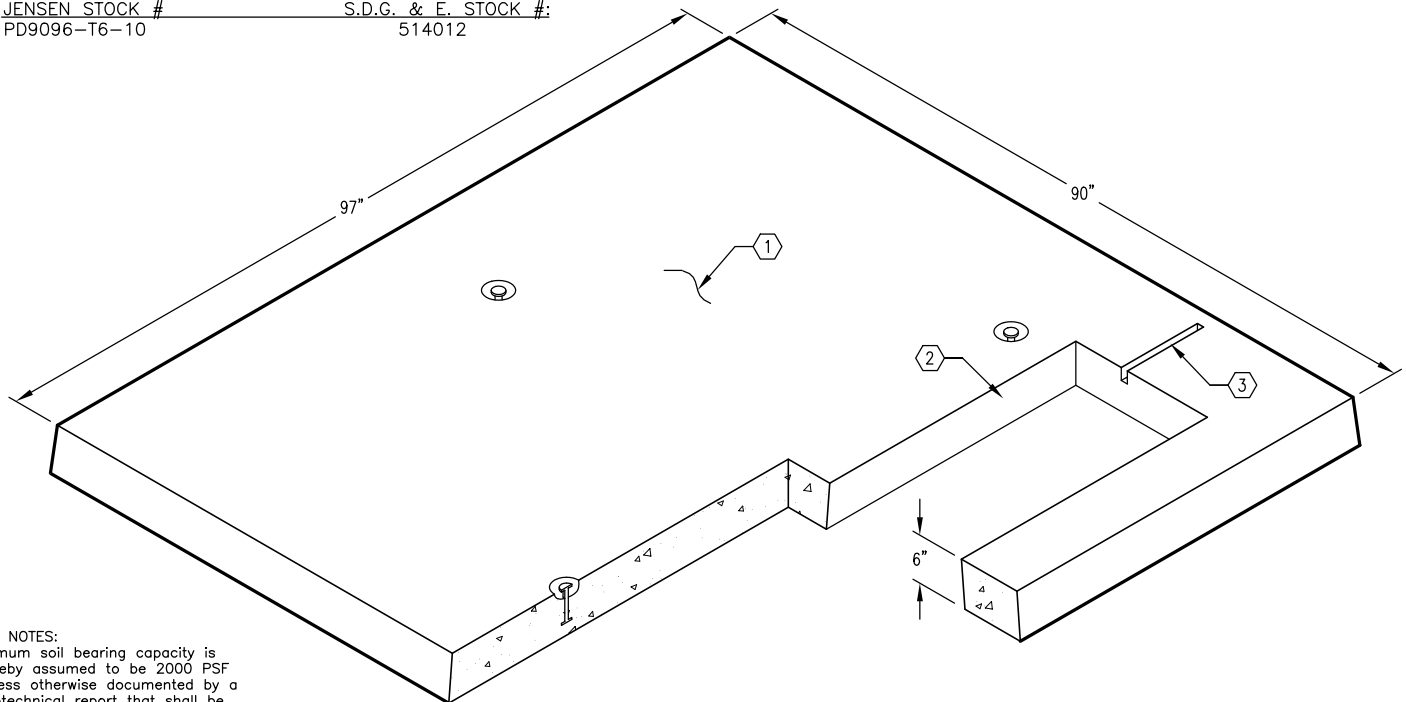


GENERAL NOTES:

1. Minimum soil bearing capacity is hereby assumed to be 2000 PSF unless otherwise documented by a geotechnical report that shall be provided to Jensen Precast by the end user. Jensen Precast shall not be held responsible for the soil bearing capacity.
2. Installation of Manholes, Vaults, Handholes, Meter Boxes etc. will be as per Jensen installation procedures.
3. Structural modification to the Jensen line of products is not permitted without prior written approval from Jensen Engineering Department.
4. Do not scale the drawings, verify all dimensions including rough openings, if any discrepancies are found, notify the Jensen Engineer immediately.
5. The Jensen Engineer will interpret the intent of the drawings in case of possible conflict or discrepancy.
6. Permissible Variations:
 Dimensional Tolerances - The length, width, height, or dia. measurements of the structure when measured on the inside surfaces shall not deviate from design dimensions by more than the following:

Dimensions:	Tolerance:
0 to 5 Feet	1/4"
5 to 10 Feet	3/8"
10 to 20 Feet as agreed upon between the supplier and purchaser.	
7. Squareness Tolerance:
 The inside of the precast concrete component shall be square as determined by diagonal measurements. The difference between such measurements shall not exceed the following:

Measured Length:	Allowable Difference
0 to 10 Feet	1/2"
10 to 20 Feet	3/4"
20 Feet and over as agreed upon between the supplier and purchaser.	

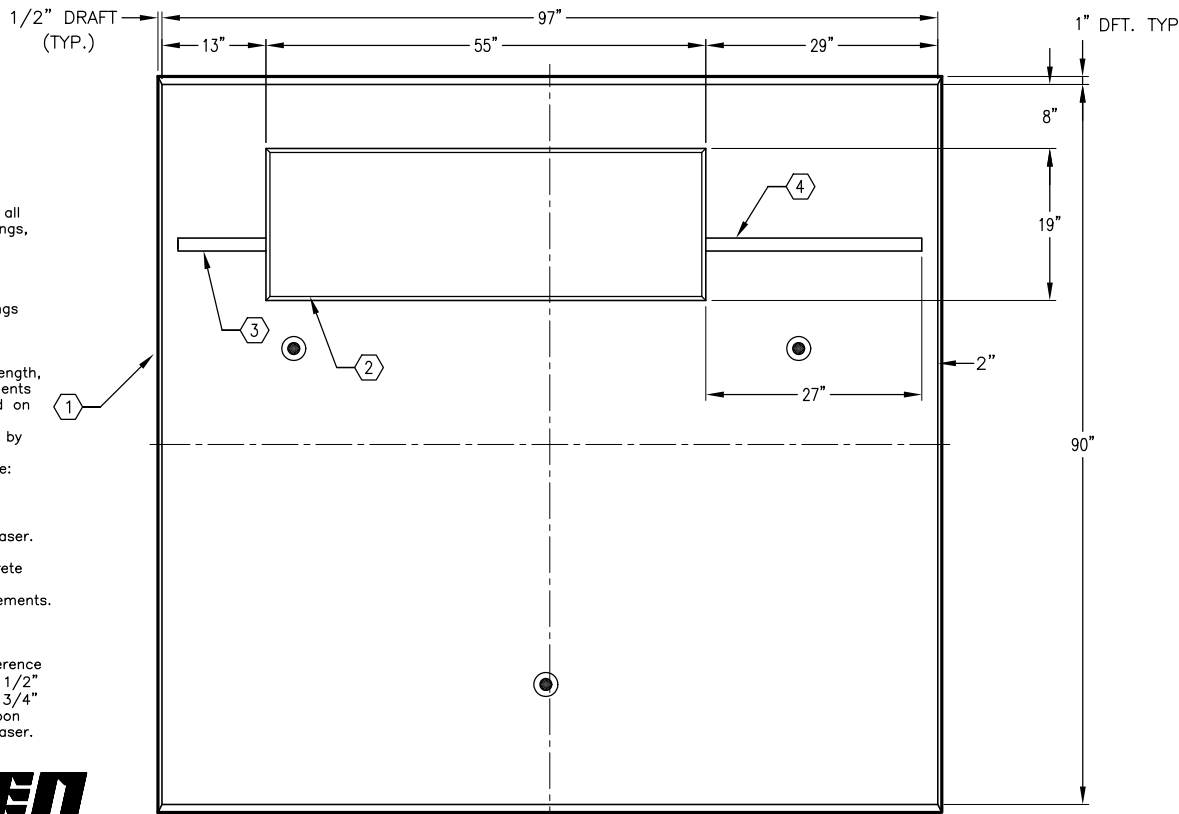

#	DATE	DESCRIPTION	BY

PD9096-T6-10
 PER S.D.G. & E. SPEC. 3427 03-01-02