DETAILS, PLAQUES & DECALS

LOCATION AND SIZING

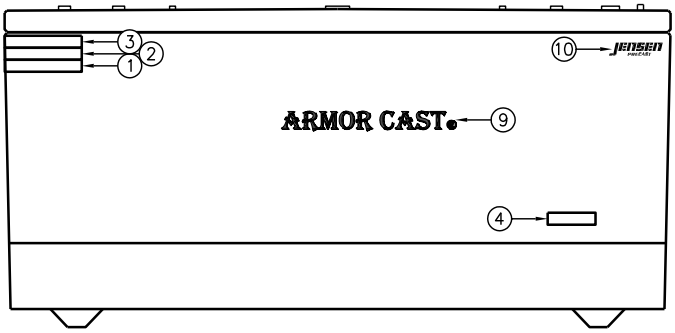

SIDE VIEW
(SINGLE COMPARTMENT ARMOR CAST TANKS)

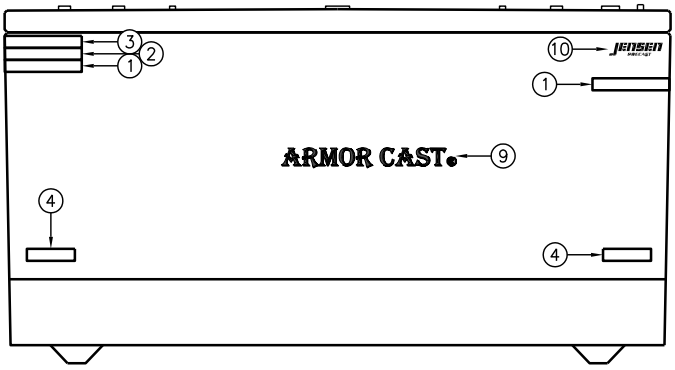

SIDE VIEW
(DUAL COMPARTMENT ARMOR CAST TANKS)

* FOLLOW INSTALATION INSTRUCTIONS.
* THESE TANKS HAVE NOT BEEN INVESTIGATED TO DETERMINE ACCEPTABILITY FOR USE AFTER FIRE EXPOSURE.
* VEHICLE IMPACT RESISTANT.
* PROJECTILE RESISTANT.
* THIS TANK IS INTENDED FO INSTALATION IN ACCORDANCE WITH EITHER NFPA-30, 30A, 31, OR THE UNIFORM FIRE PREVENTION CODE AS APPLICABLE.

PLAQUE "A"

CONTAINMENT MANAGEMENT SYSTEMS

MODEL _____
GALLONS _____
MFG. DATE _____

PLAQUE "B"

THIS TANK REQUIRES EMERGENCY RELIEF VENTING. CAPACITY NOT LESS THAN _____ CUBIC FEET PER HOUR.

PLAQUE "C"

KEEP LID CLOSED AND LOCKED AT ALL TIMES

PLAQUE "D"
(OVERFILL CONTAINER)



OVERFILL CONTAINER

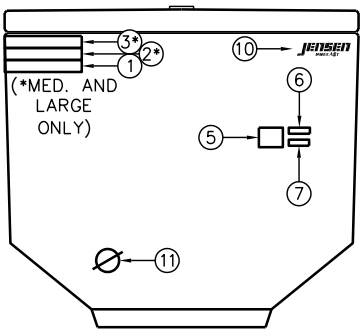

END VIEW

NO.	DESCRIPTION	SMALL	MEDIUM	LARGE
1	FUEL TYPE	•	•	•
2	FLAMABLE OR COMBUSTIBLE	•	•	•
3	NO SMOKING	•	•	•
4	TANK CAPACITY	•	•	•
5	PLAQUE "A"	•	•	•
6	PLAQUE "B"	•	•	•
7	PLAQUE "C"	•	•	•
8	PLAQUE "D"	•	•	•
9	ARMOR CAST LOGO	•	•	•
10	JENSEN PRECAST LOGO	•	•	•
11	NO RUST	•	•	•

1. EACH PORT ON TOP OF THE TANK WILL BE IDENTIFIED WITH A PLAQUE.

2. OVERFILL CONTAINERS WILL BE LABELED WITH FUEL TYPE, TANK CAPACITY, AND PLAQUE "D" (SEE ABOVE).

3. TANK LABELING IS STANDARD FOR ALL ARMOR CAST TANKS.

FOR COMPLETE DESIGN AND PRODUCT INFORMATION CONTACT JENSEN PRECAST.

4/12/00
DECAL_PLACEMENT.dwg
© 2000 Jensen Precast

JENSEN PRECAST®