

4'-6" x 8'-6" PARKWAY WATER VAULT x 47" DEEP

NOTES:

- DESIGNED IN ACCORDANCE WITH AASHTO H-20-44 TRAFFIC BRIDGE LOADING USING 5,500 PSI [37.92MPa] COMPRESSIVE STRENGTH CONCRETE AND 60,000 PSI [413.2MPa] YIELD STRENGTH ASTM A-706 STEEL REINFORCEMENT PER CALC. #31891.
 - COVER DESIGNED FOR PARKWAY LOADING @ 300 P.S.F. PER CALC. #
 - HANDHOLE TO BE PLACED ON A 6" [15cm] BASE OF CRUSHER RUN FOR EASE OF INSTALLATION AND EVEN LOAD DISTRIBUTION.
1. PB4686-L42-08, 42" LOWER SECTION, WT. 7.037 lbs.
 2. Q4686-PRW, PARKWAY COVER ASSEMBLY, INCLUDES:
 - (1) F4686-PB-BD FRAME, (7) SC84686-123 I BEAMS, (4) SC4686-RD RED COVER, (32) 1/2" PLATED SHAKEPROOF WASHER, (16) 1/2" x 1-1/2" H.H.S.S. BOLTS,
 - (16) 1/2" UNISTRUT SPRING NUTS, WT. 1,060 lbs.
 - (12" x 12" PIPE SLOT KNOCKOUT x 5" DEEP, LOCATE AS FOLLOWS: LOWER SECTION, (2) SHELL MTD.

ORDERING INFORMATION:


K4686-FH48-08P FOR ASSEMBLY, AS SHOWN
TOTAL ASSEMBLY WT. 8,097 lbs.

GENERAL NOTES:

1. Minimum soil bearing capacity is hereby assumed to be 2000 PSF unless otherwise documented by a geotechnical report that shall be provided to Jensen Precast by the end user. Jensen Precast shall not be held responsible for the soil bearing capacity.
2. Installation of Manholes, Vaults, Handholes, Meter Boxes etc. will be as per Jensen installation procedures.
3. Structural modification to the Jensen line of products is not permitted without prior written approval from Jensen Engineering Department.
4. Do not scale the drawings, verify all dimensions including rough openings, if any discrepancies are found, notify the Jensen Engineer immediately.
5. The Jensen Engineer will interpret the intent of the drawings in case of possible conflict or discrepancy.
6. Permissible Variations: Dimensional Tolerances - The length, width, height, or dia. measurements of the structure when measured on the inside surfaces shall not deviate from design dimensions by more than the following:

Dimensions:	Tolerance:
0 to 5 Feet	1/4"
5 to 10 Feet	3/8"

 10 to 20 Feet as agreed upon between the supplier and purchaser.
 Squariness Tolerance:
 he inside of the precast concrete component shall be square as determined by diagonal measurements. The difference between such measurements shall not exceed the following:
 Measured Length: Allowable Difference
 0 to 10 Feet 1/2"
 10 to 20 Feet 3/4"
 20 Feet and over as agreed upon between the supplier and purchaser.
- 7.

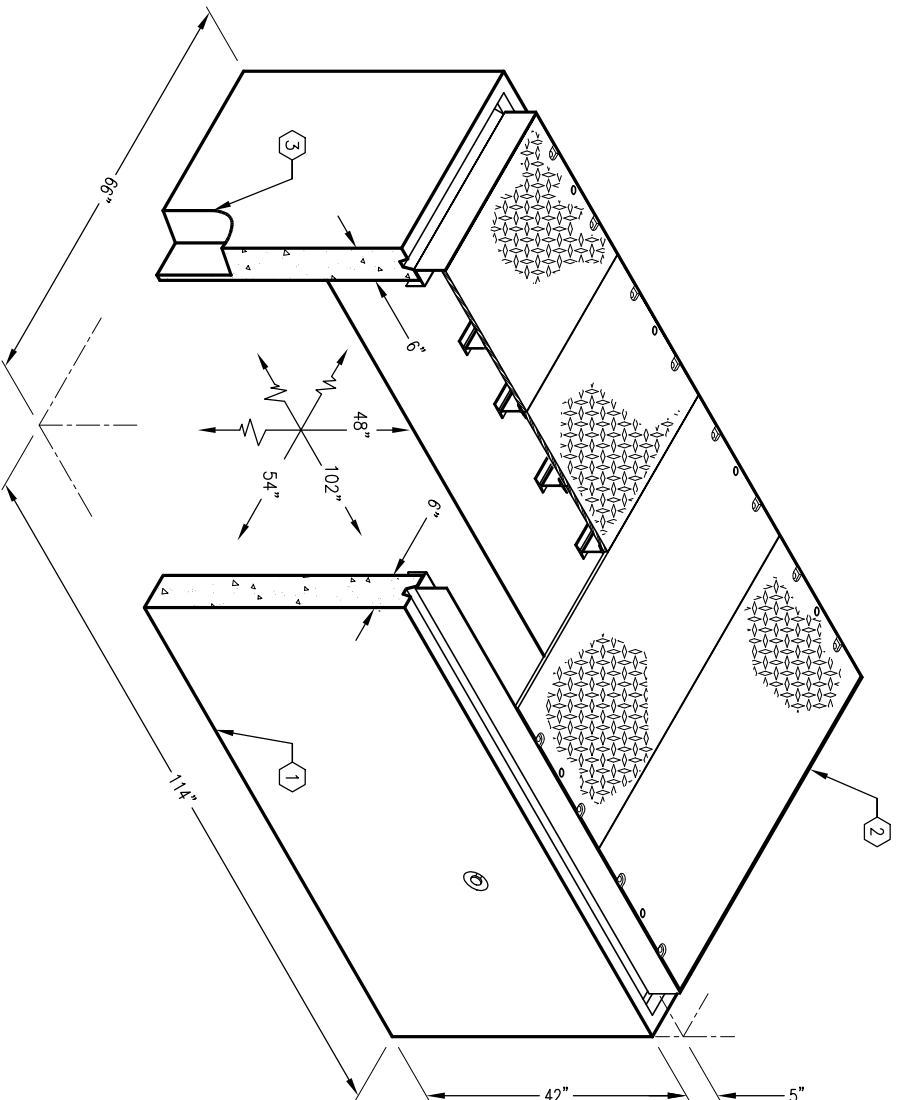


MINIMUM EXCAVATION SIZE:
6'-6" x 10'-6" x DEPTH REQ'D
PER CUSTOMER SPECS.

K4686-FH48-08P




AUTOCAD REL. 14

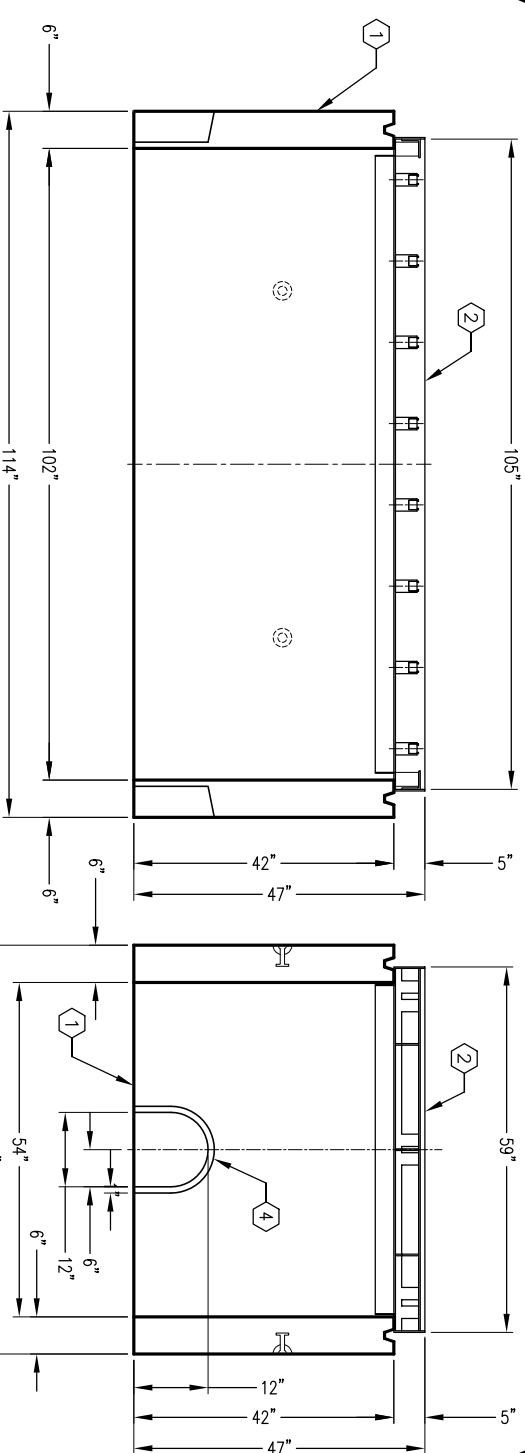


SECTION A-A

SECTION B-B

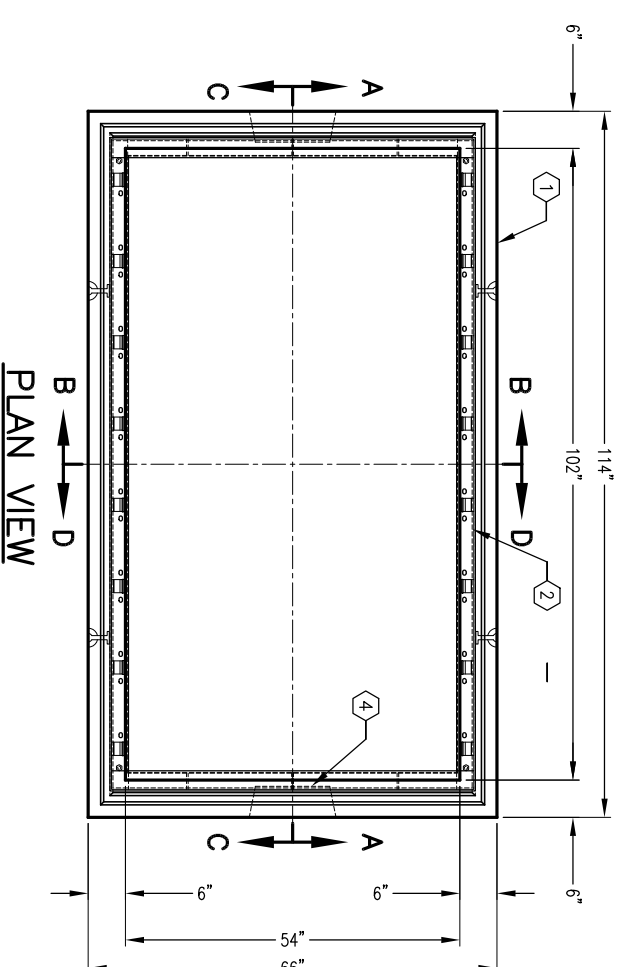

PLAN VIEW

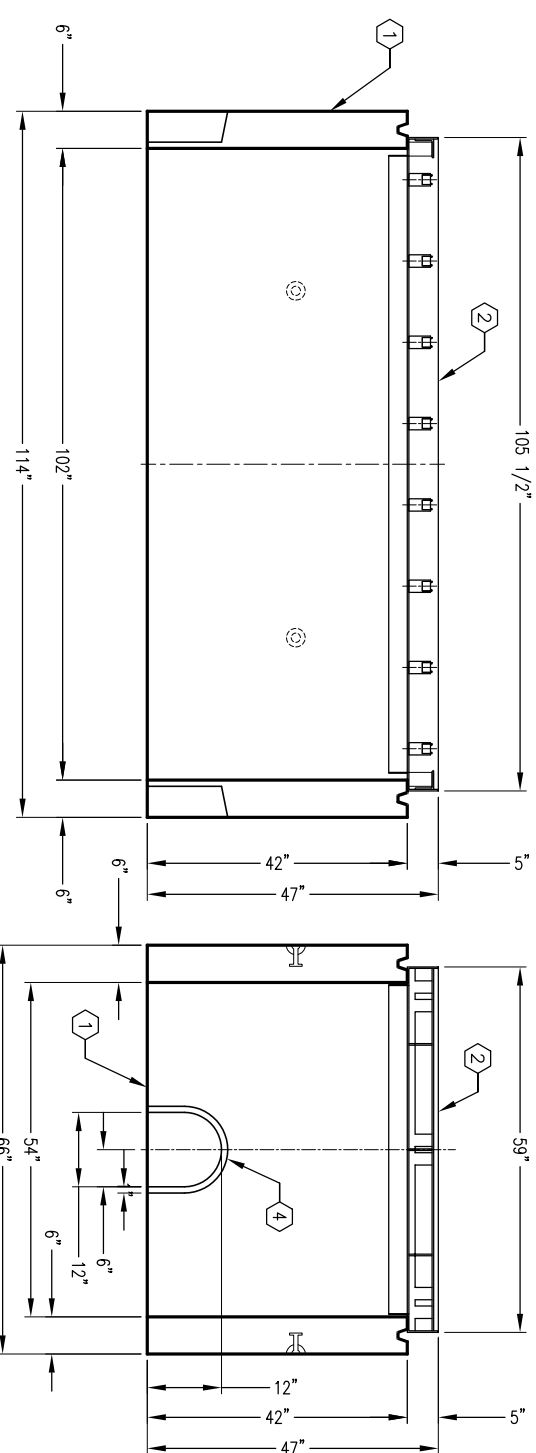

SECTION C-C

SECTION D-D

#	DATE	DESCRIPTION	BY

K4686-FH48-08P



AUTOCAD REL. 14